

# MINI DOCKING STATION

with **PowerFill**


## Installation Instructions

**CAUTION:** Improper installation, operation or servicing will result in equipment damage and personal injury. This product should be installed and serviced by qualified technical personnel who are familiar with the construction, "operation" and potential hazards of this type of connection.




- The B&B installed connections on the back of the Mini Docking Station are torqued to specific settings. Loosening or tightening these connections will result in leakage to these fittings.
- Over tightening or loosening water connections will result in leakage or damage.
- Do not "operate" the equipment at power levels other than what is specified on the equipment serial tag and data plate.
- All plumbing connections made to this product during installation should be hand tight plus ¼ turn.
- Failure to follow these instructions for installation of our product will forfeit any warranty consideration.

1. Cut a 6" x 4-7/8" opening in sidewall and feed appropriate connections through opening.

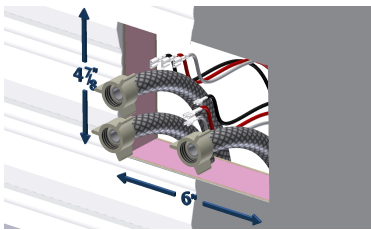


2. Apply putty tape or foam gasket to back of Mini Docking Station covering pre-drilled mounting holes.




PUTTY TAPE

3. Connect plumbing line from fresh water tank to the "TO TANK" connection identified on back of Mini Docking Station dish.

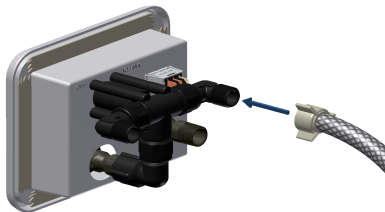

4. Connect plumbing line for city water connection to the "CITY" connection identified on back of Mini Docking Station.

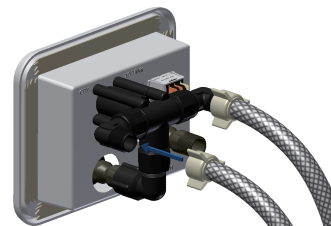

58471 Fir Road, Mishawaka, IN 46544

Phone: (574) 259-7838 Fax: (574)

259-7939

[www.bandbmolders.com](http://www.bandbmolders.com)


# MINI DOCKING STATION

with **PowerFill**


## Installation Instructions

(cont.)


5. Connect plumbing line for winterizing or tank flushing system to "WINTERIZE" OR "TANK FLUSH" connection identified on back of Mini Docking Station.

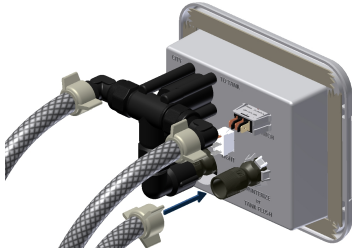


6. Connect power source to terminal on back of light switch and test for operation.

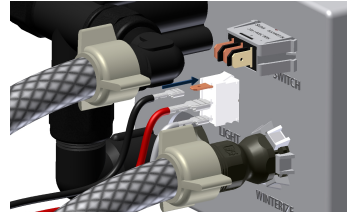


7. Connect power service to terminals on back of pump switch and test for operation.

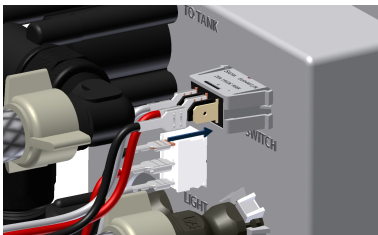

8. Please pressure test (per RVIA Code) all connections prior to securing Mini Dock Station to sidewall.

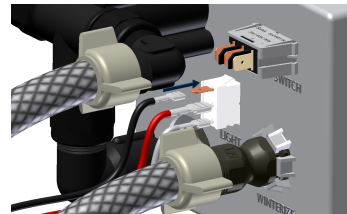

9. Once successful pressure testing is complete, position Mini Docking Station hatch into cutout opening and secure to sidewall w/all (8) #8 self-tapping screws.

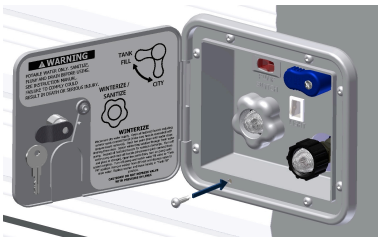

10. Open and close hatch door a few times to ensure proper functioning.

\*If hatch door does not close and lock properly, mounting screws may be too tight.

11. Cap seal outside perimeter of Mini Docking Station for waterproofing.



58471 Fir Road, Mishawaka, IN 46544

Phone: (574) 259-7838 Fax: (574)

259-7939

[www.bandbmolders.com](http://www.bandbmolders.com)